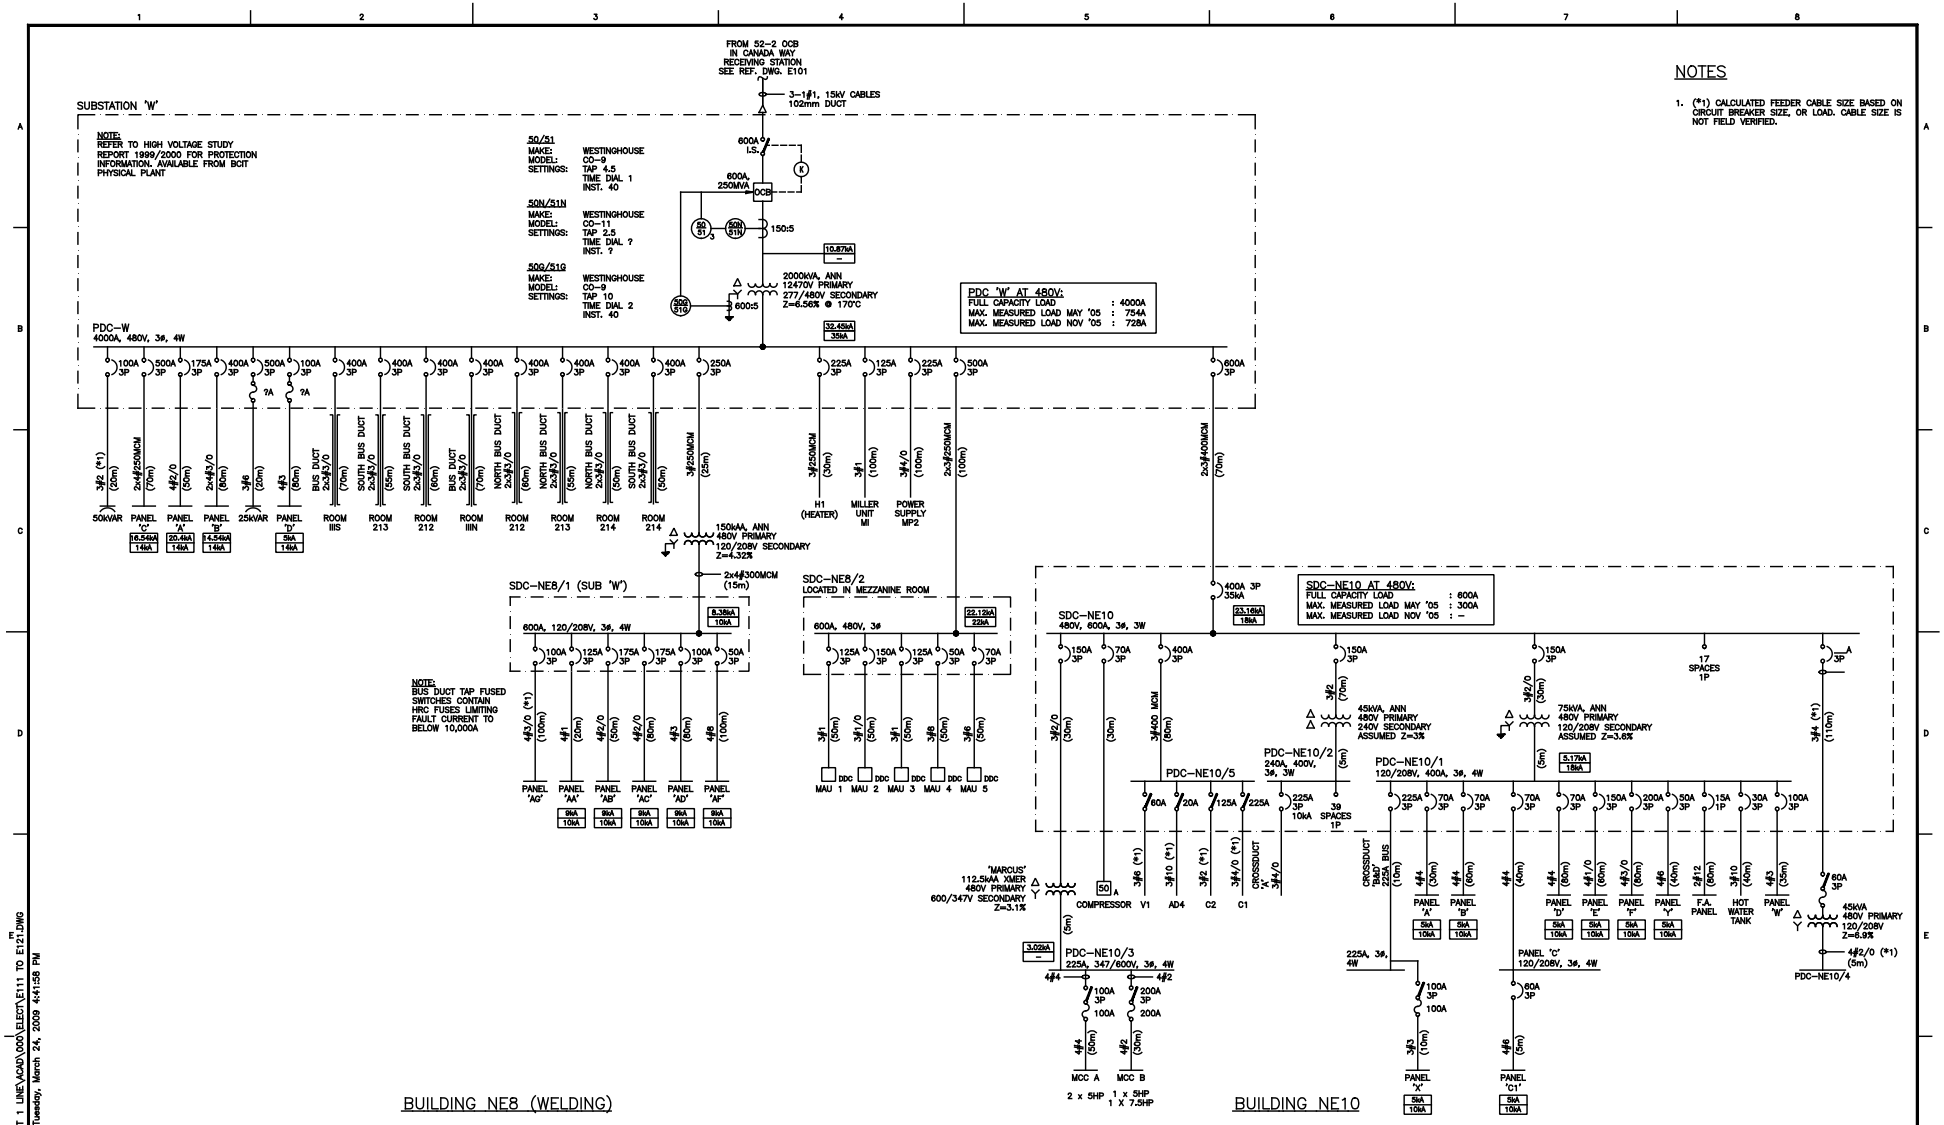


## NOTES

1. (*1) CALCULATED FEEDER CABLE SIZE BASED ON CIRCUIT BREAKER SIZE, OR LOAD. CABLE SIZE IS NOT FIELD VERIFIED.

| REV. | BY | DATE | REVISION | APP'D |
|---|---|---|---|---|
| P1 | MM | 2009.03.23 | ISSUED FOR REVIEW | FS |

| REV. | BY | DATE | REVISION | APP'D | DWG. No. | REFERENCE | REV. No. |
|---|---|---|---|---|---|---|---|
| | | | | | . | . | . |

speed and precision worldwide
Sandwell
Sandwell Engineering Inc.
888 DUNSMUIR ST., SUITE 600,
VANCOUVER, B.C. V6C 1N5
(604) 684-9311

| SANDWELL PROJECT NO. | DATE | SCALE |
|---|---|---|
| 114739 | 2009.03.18 | NONE |
| ENG. OF RECORD | DESIGN | DESIGN CHECK |
| | | DRAWN LT |
| | | DRAWING CHECK MM |

BCIT BRITISH COLUMBIA INSTITUTE OF TECHNOLOGY

PROJECT NAME
B.C. INSTITUTE OF TECHNOLOGY
SINGLE LINE DIAGRAM

SHEET TITLE
NORTH CAMPUS – SUBSTATION 'W'
BUILDINGS NE8 & NE10

SHEET NO.
E111

CAD FILENAME
114739-E111

REV.
P1

J:\UNIT_1\1\114739 BCIT 1 LINE\ACAD\000\ELECT\E111 TO E121.DWG
Tuesday, March 24, 2009 4:41:58 PM