


NOTE
ALL WIRING IN GREENHOUSE SHALL BE 1/2" MIN. O.D. E-90
AS REQUIRED BY CODE. IN RIGID ALUM. CONDUIT, HOME RUNS
INCLUDES INDICATED OTHERS ON THE PLAN
WIRING IN ALL OTHER AREAS SHALL BE 1/4" MIN. O.D.
OR NMDZ AS REQUIRED BY CODE.

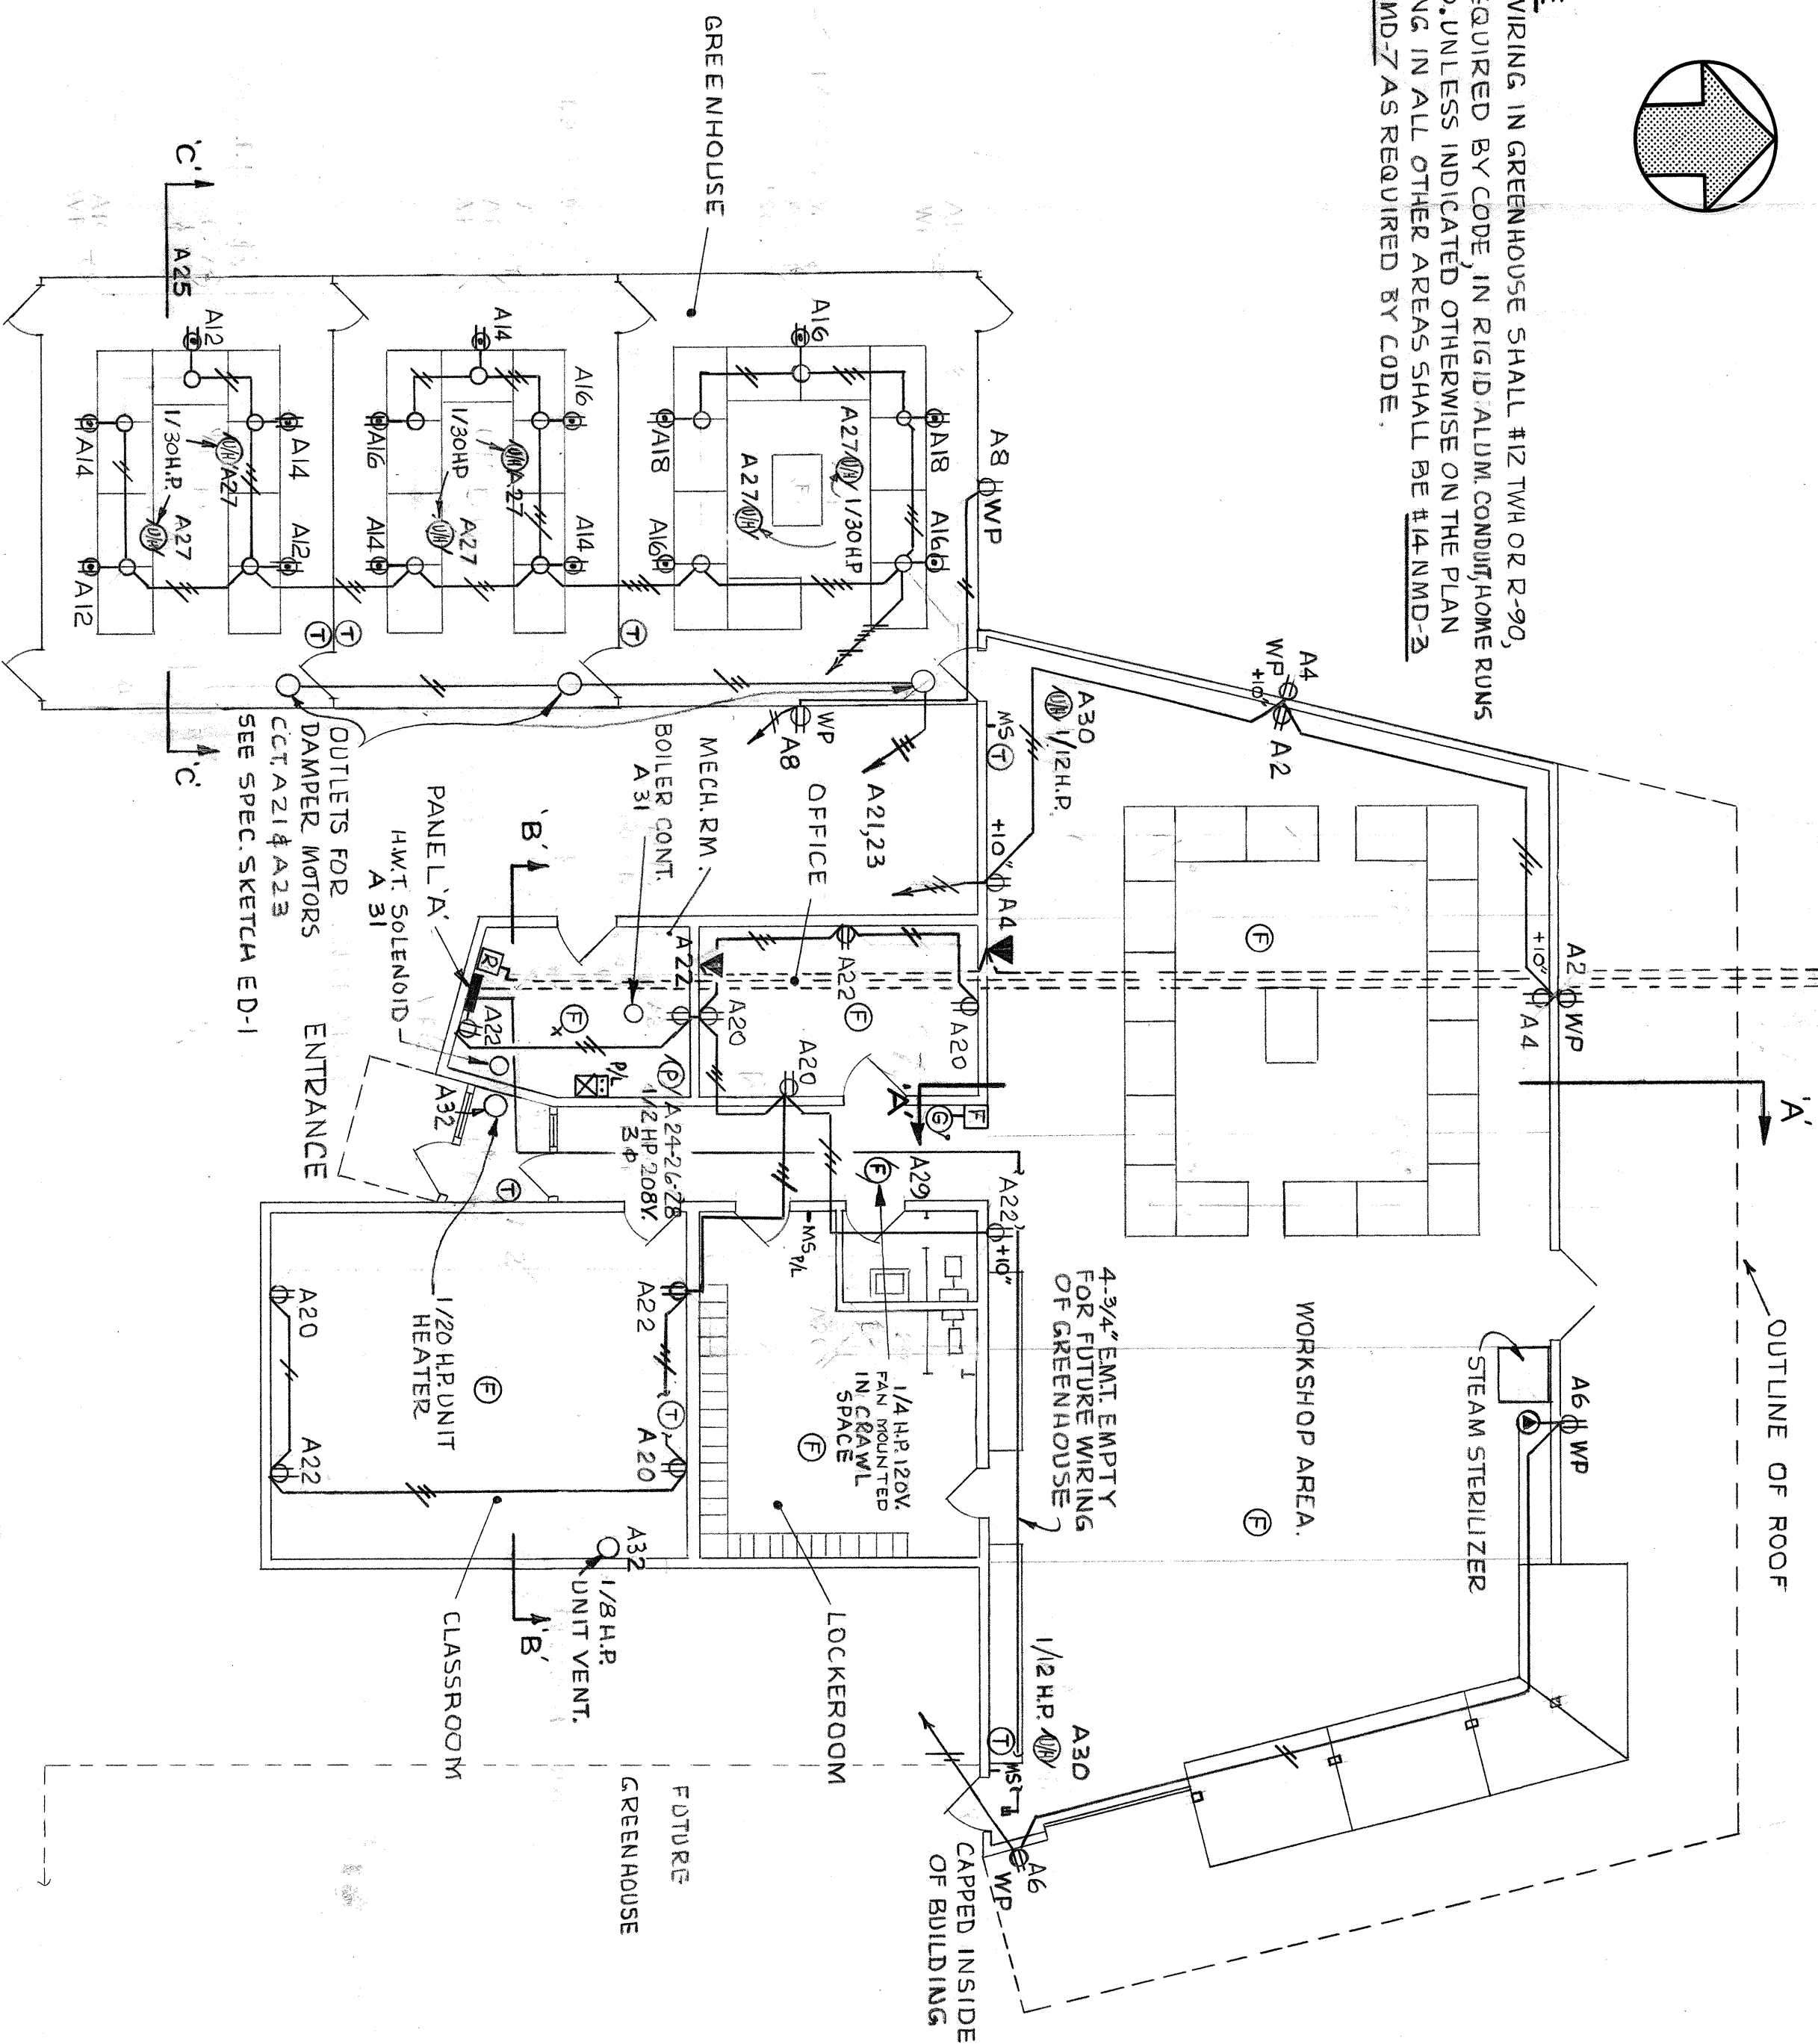

POWER & F.A. FLOOR PLAN


NOTE:
ALL WIRING IN THE GREENHOUSE SECTION
INDOORS & OUTDOORS SHALL BE DONE WITH
RIGID ALUM. CONDUIT. ALL BOXES SHALL BE
'EP' OR 'FS' CAST ALUM. CONDUITS. GELING
OUTLETS SHALL BE TYPE VXF & QPF ALSO OF
CAST ALUMINUM.

0 4 8 12 16 FEET

#54151L BOX
(WORKSHOP AREA
ONLY)


KELLEYS SR-9
STRAIN RELIEF GRIP

HUBBELL
H-334 CORD
HUBBEL CONT # 5207




TYPICAL DROP CORD ASSEMBLY
N.T.S.


#3 TENSO LION CHAIN



SECTION C-C



SECTION B-B










LIGHTING FLOOR PLAN

NOTE
F.A. TELEPHONE WIRING
TO BE TERMINATED AND RUN
DOWN POLE SIMILAR TO
POWER.

0 4 8 12 16 FEET

#3 TENSO LION CHAIN
P-1000 #1/2 GAUGE
UNISTRUT

LIGHT FIXTURE SUSPENSION METHOD
CHAIN SPACING 8' MAXIMUM

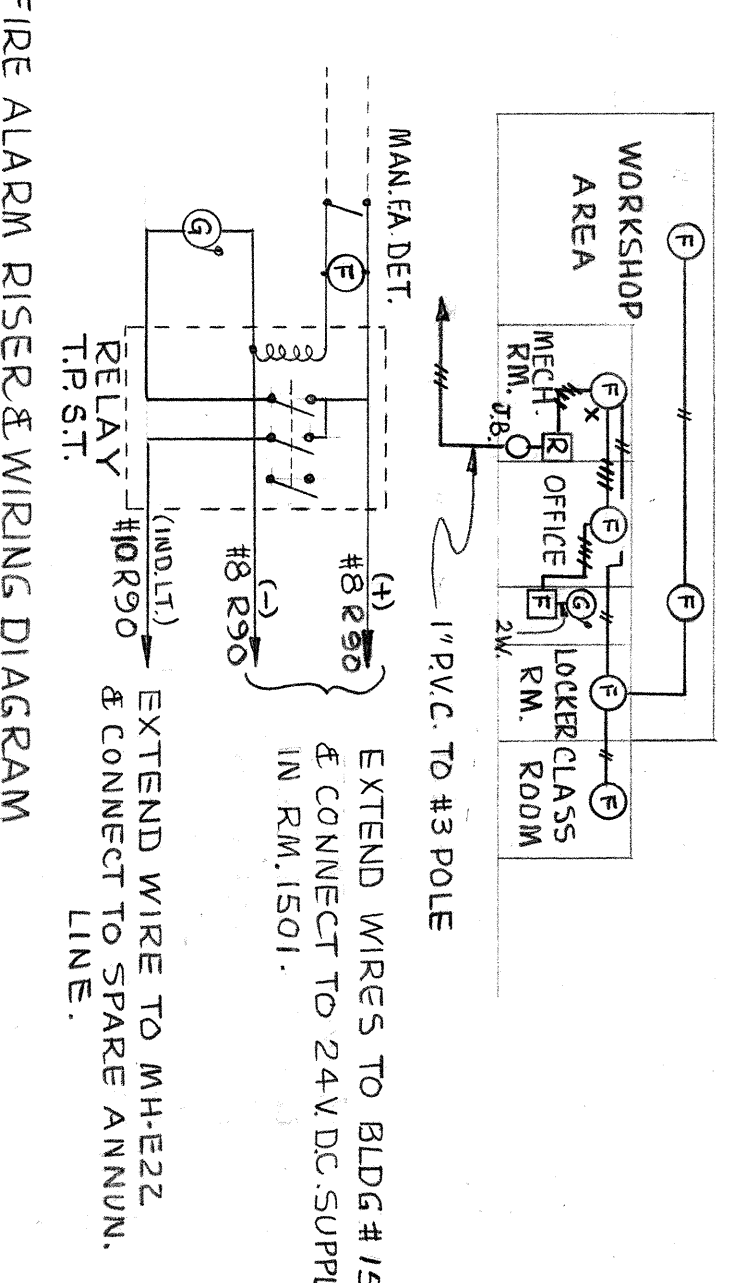

LEGEND

- SPECIAL PURPOSE OUTLET
- DUPLEX RECEPTACLE
- SINGLE DROP CORD RECEPTACLE
- JUNCTION BOX
- SINGLE POLE SWITCH
- 2/40W FLUORESCENT LIGHT
- 1/40W FLUORESCENT LIGHT
- WEATHER PROOF
- PANEL
- MOTOR INSCRIBED - F - FAN
- MANUAL STR. P - PUMP
- AUTO F.A. DETECTOR 135°
- AUTO F.A. DETECTOR 190°
- MAIN F.A. DETECTOR
- F.A. RELAY
- F.A. GONG
- TELEPHONE OUTLET
- DISCONNECT SW.
- EXT LIGHT WALL MNT
- CLOCK OUTLET
- THERMOSTAT
- H-O-A
- HAND-OFF-AUTO

NE03.1971-09 E1

HORTICULTURAL TRAINING BUILDING		B. C. V. S. BURNABY, B. C.		ELECTRICAL	
155769		155769		20-102	
SHEET REPRODUCTION SIZE SCALE		DIRECTOR OF DESIGN		DESIGNED	
1" = 10'		DATE SEPT. 1971		CHECKED	
TERMS		GOVERNMENT OF BRITISH COLUMBIA		A.M.	
		HON. W. A. SCHMIDT - MINISTER		E-1	