




02-08-B19331-M1

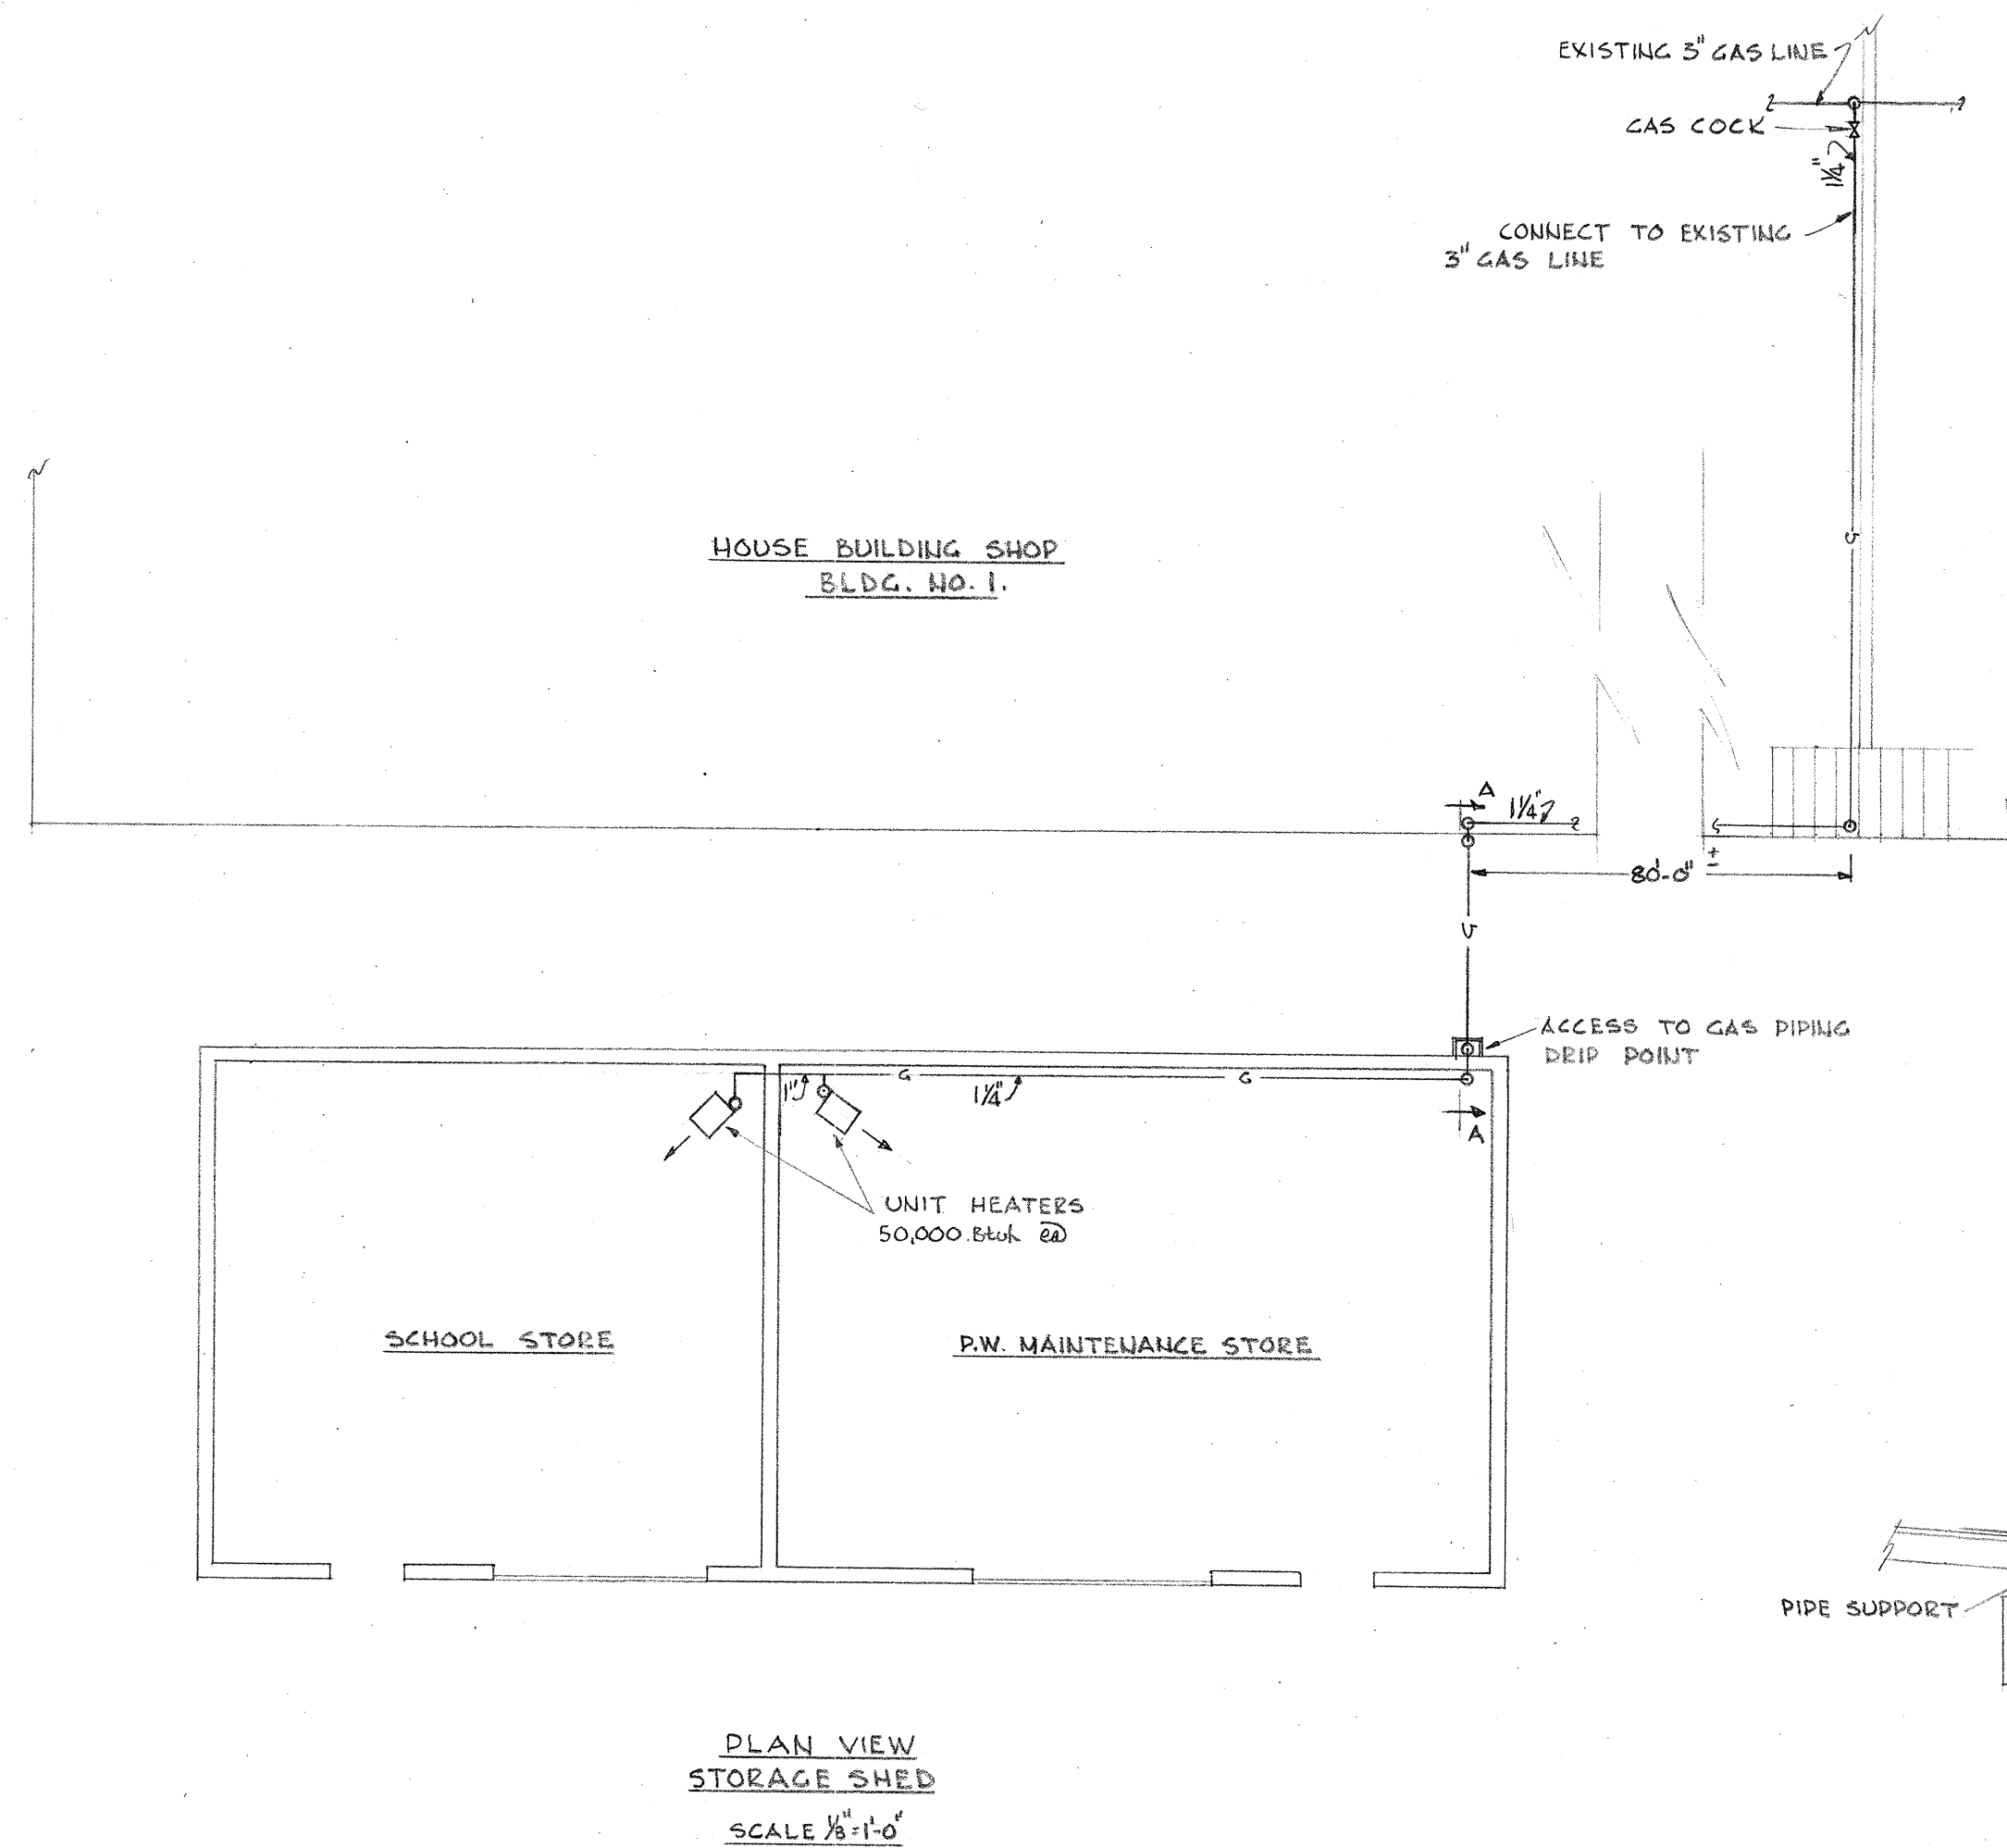

NOTES

1. UNIT HEATERS (2) - 50,000 Btu/h INPUT THERMOSTATICALLY CONTROLLED TO MAINTAIN A TEMPERATURE OF 60°F WITHIN THE STORES BLDG. (TO BE SUPPLIED BY SCHOOL). HEATERS TO BE SUSPENDED FROM ROOF JOISTS AS HIGH AS POSSIBLE.
2. FROM EACH HEATER PROVIDE & INSTAL A 4" VENT PIPE THROUGH THE ROOF TERMINATING A MIN. OF 2'-0" ABOVE THE ROOF. A VENTILATED THIMBLE SHALL BE USED WHERE VENT PASSES THROUGH ROOF. (SEE DETAIL FOR ARRANGEMENT)
3. JOINTS IN UNDERGROUND PIPING ARE TO BE WELDED. PIPING TO BE GRADED TO DRIP POINT. ALL PIPING TO BE INSTALLED IN ACCORDANCE WITH B.C. PROV. REGULATIONS GOVERNING THE INSTALLATION OF GAS PIPING & APPLIANCES.



NE04_1961-03_M1

TITLE OF CONTRACT No 20-9-M1

BRITISH COLUMBIA VOCATIONAL SCHOOL BURNABY, B.C.
STORAGE SHED FOR P.W.D. & SCHOOL.

REVISIONS			
No.	Date	Item	Initials

Drawn by: H.K.	TITLE OF DRAWING		Scale AS SHOWN
Checked by: J.M.	HEATING ~ PLAN & DETAILS		File No.
Approved:	MECHANICAL	SHT. 1 OF 1	Date 10/3/61
PROVINCIAL GOVERNMENT OF BRITISH COLUMBIA DEPARTMENT OF PUBLIC WORKS			Drawing No. 4638 M1

39628

030303